






THE FRAME



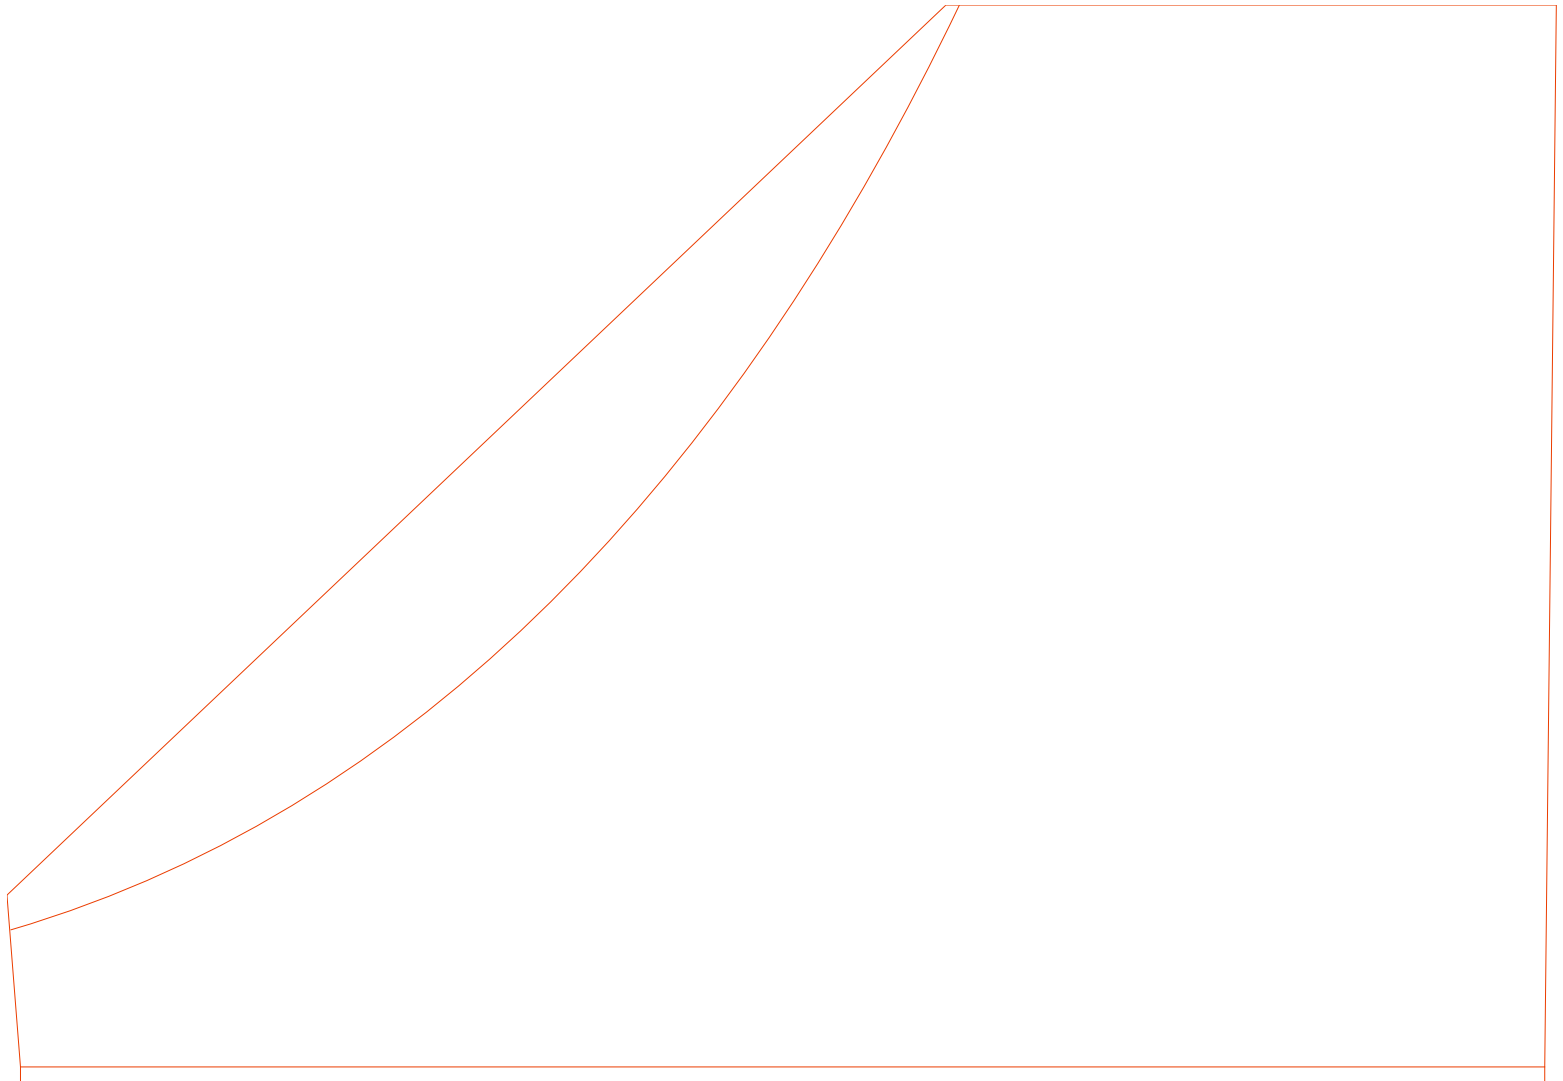


**HUMIDITY RATIO
IN GRAMS OF
MOISTURE PER
KG DRY AIR**

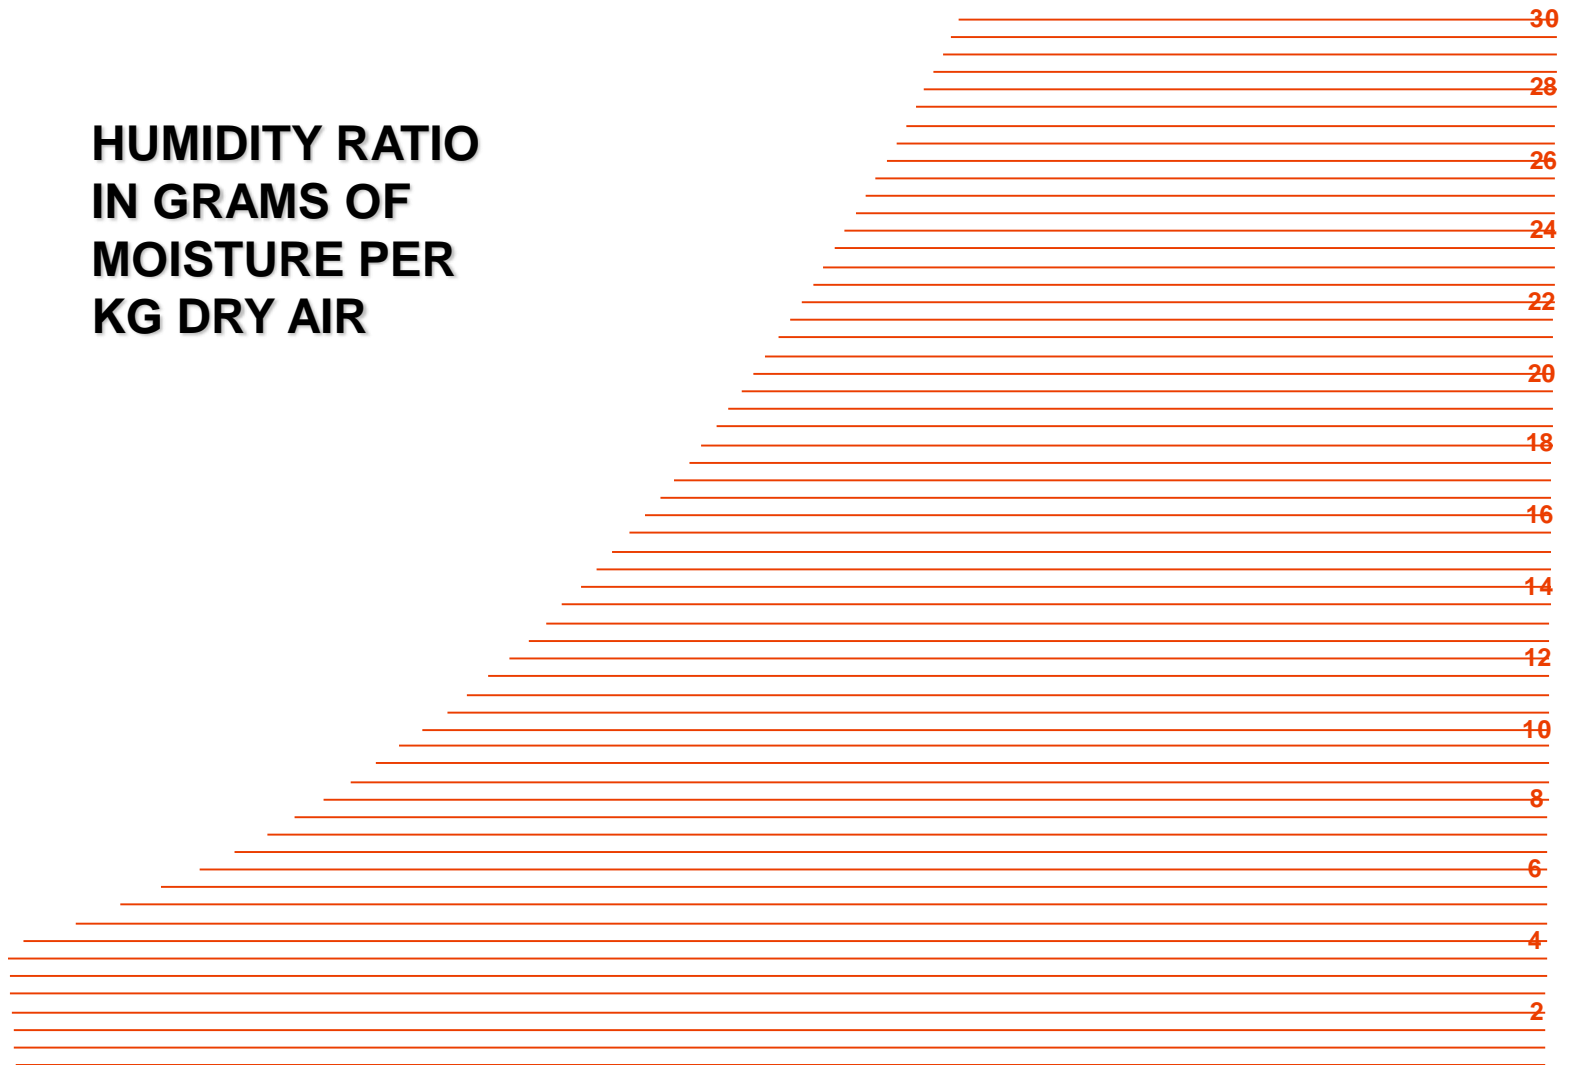


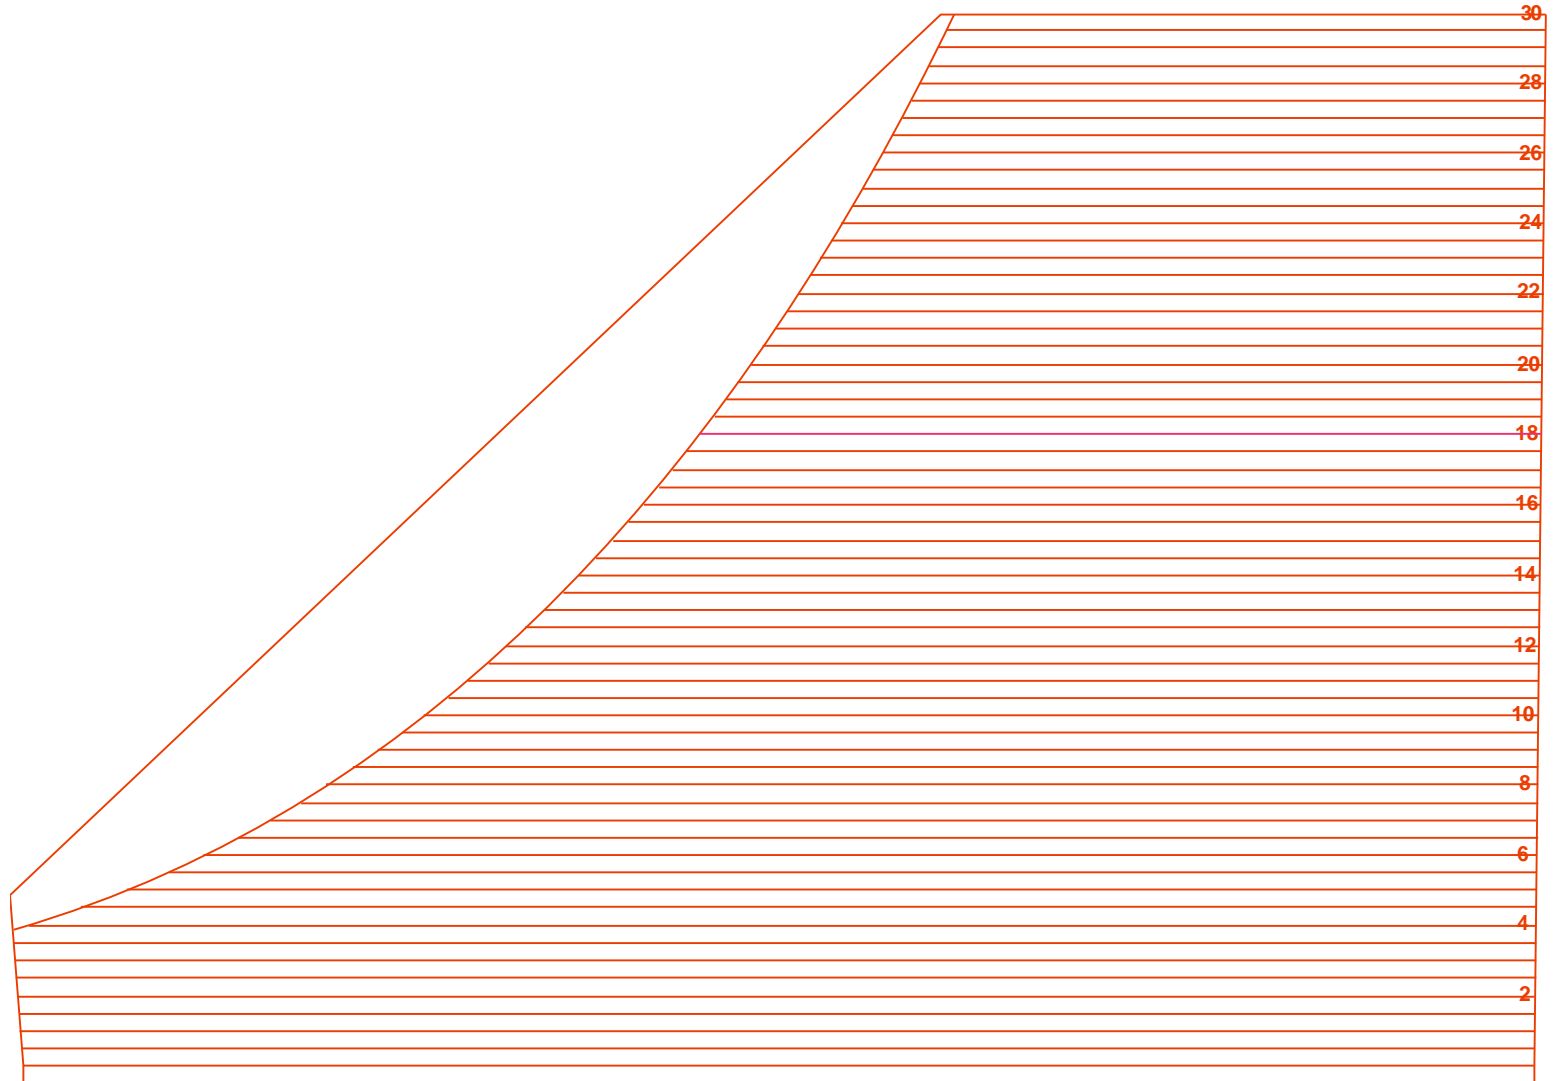




ENTHALPY AT INTERVALS OF 10 KJ/KG OF DRY AIR

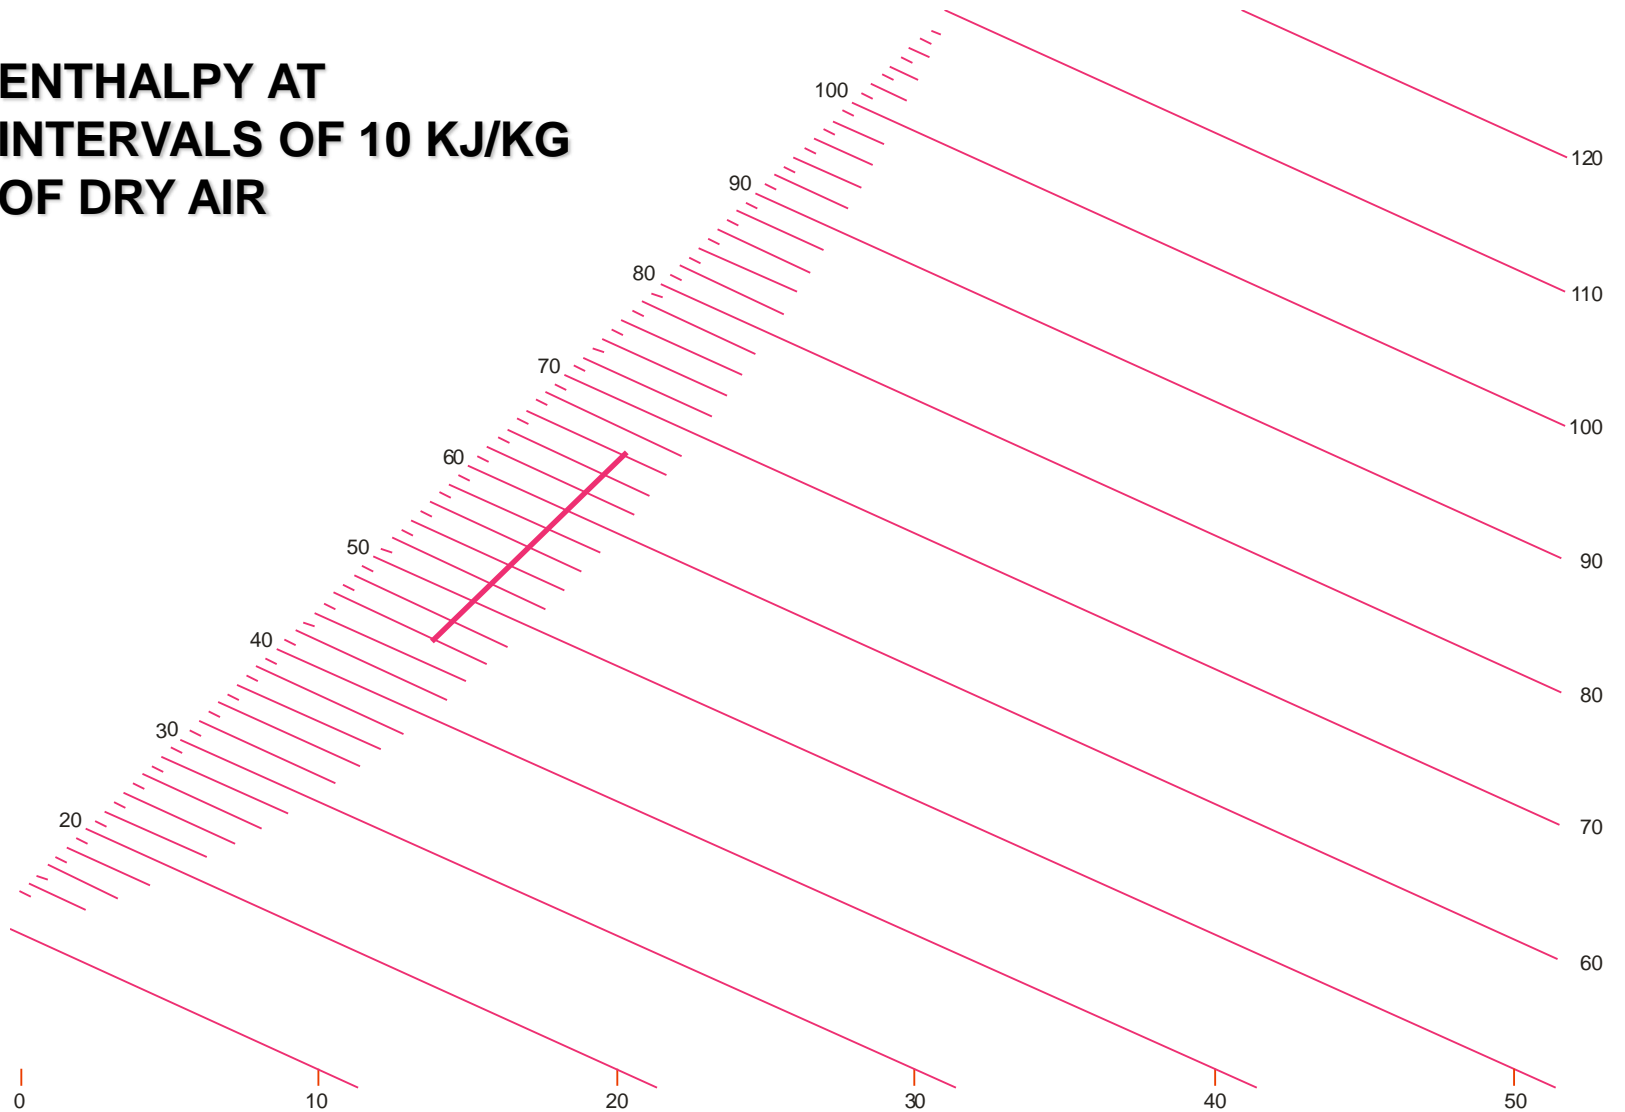


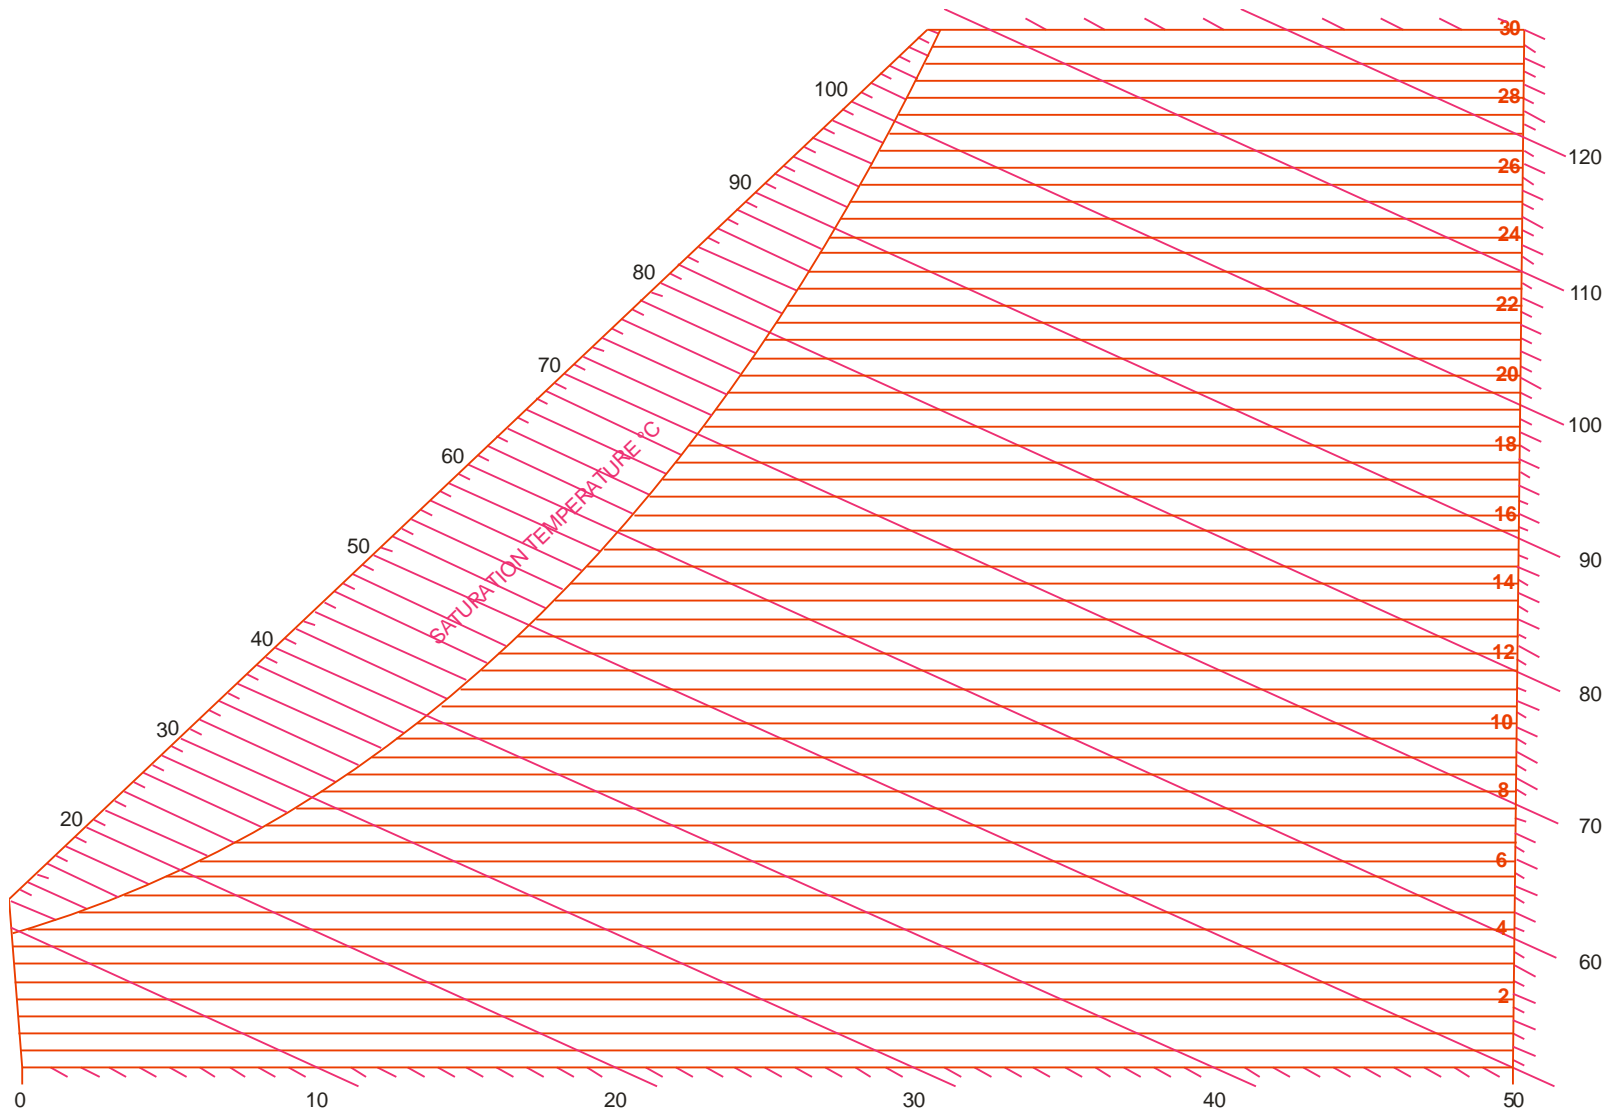




DRY- BULB TEMPERATURE LINES AT 1°C INTERVALS

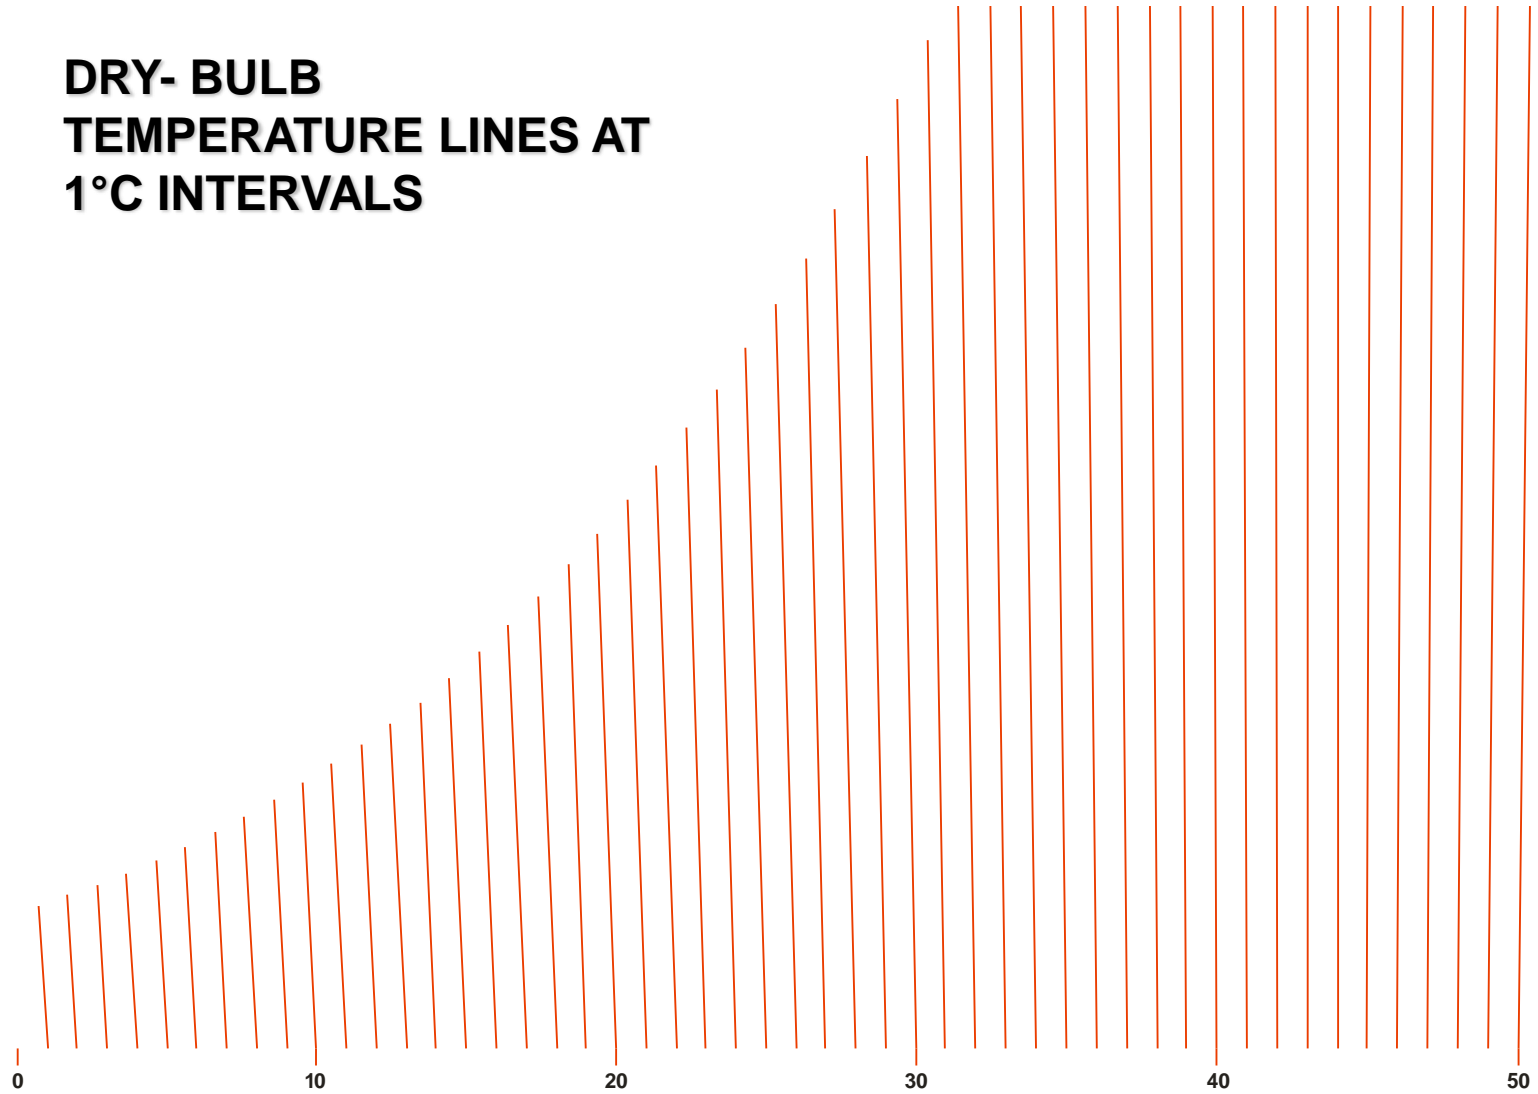


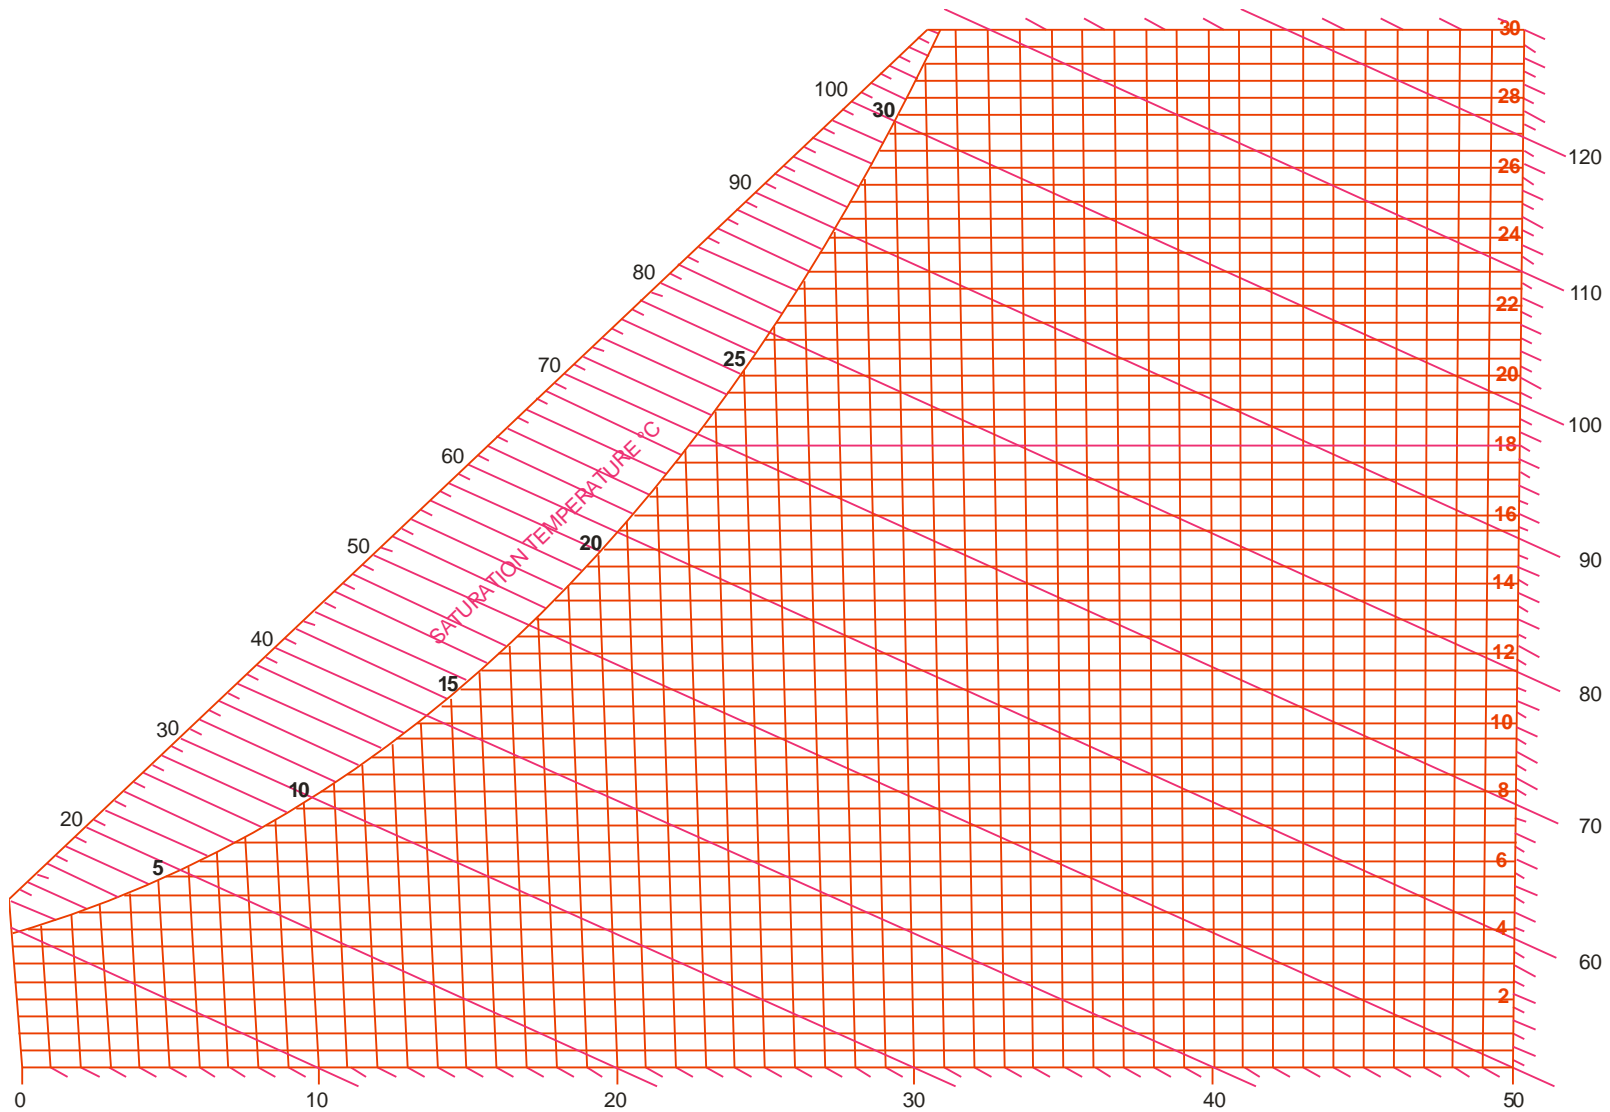




WET-BULB TEMPERATURE LINES AT 1°C INTERVAL

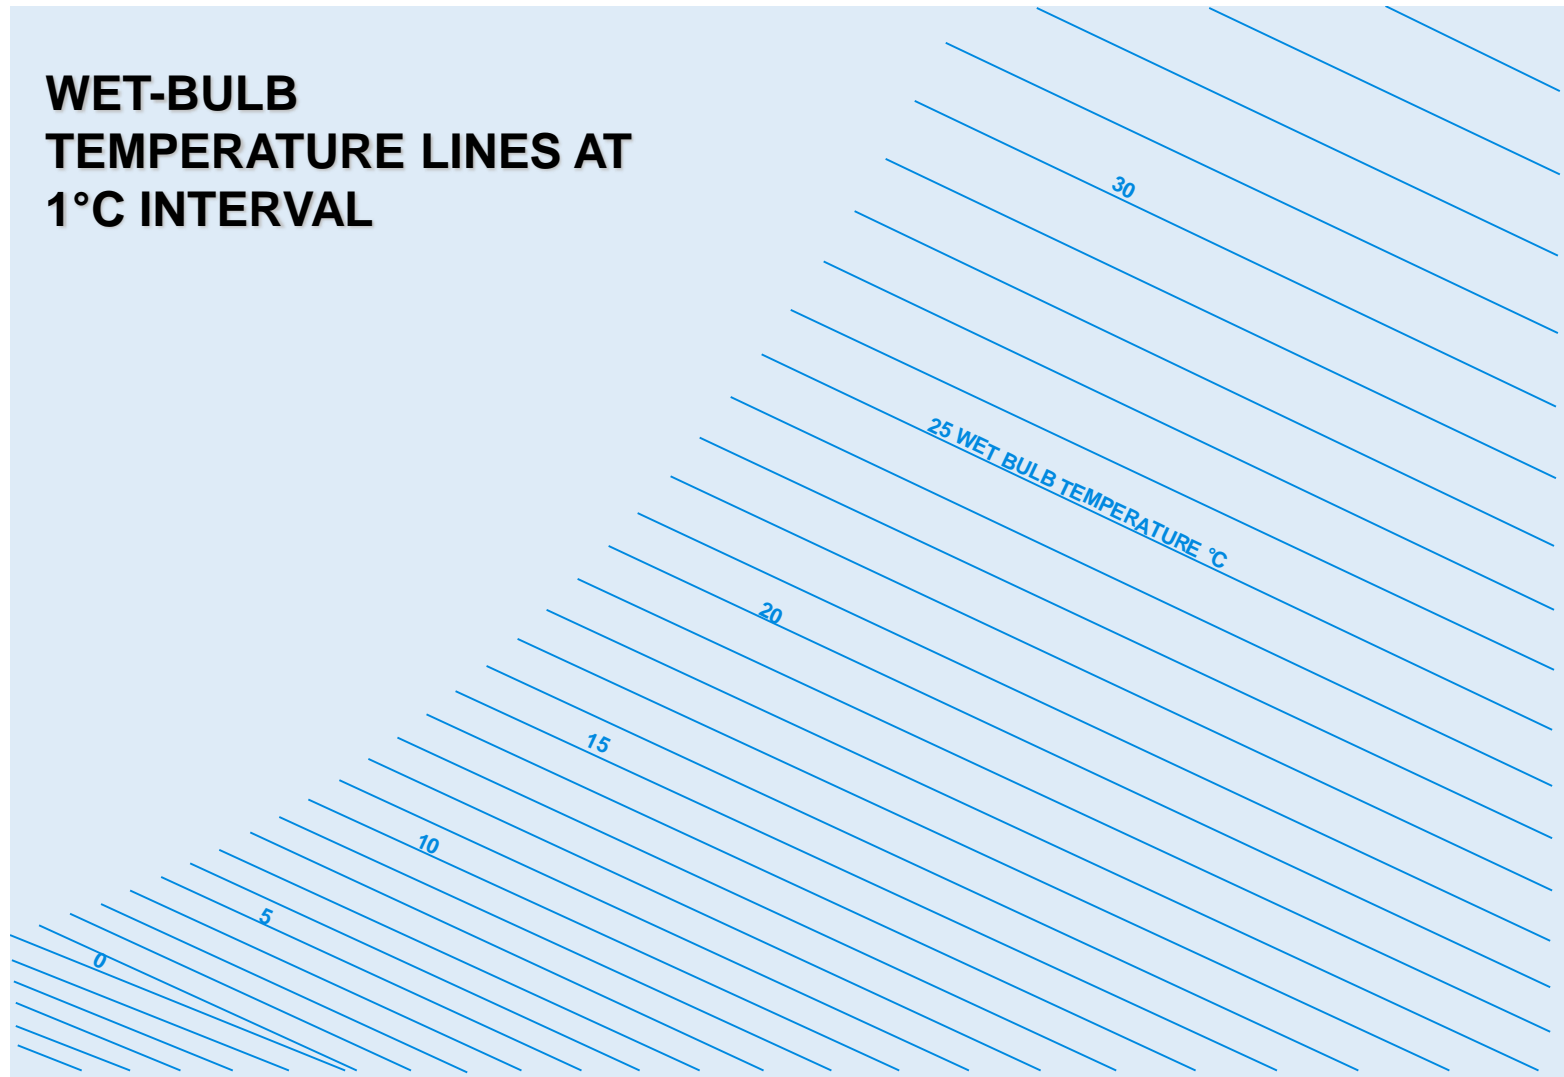


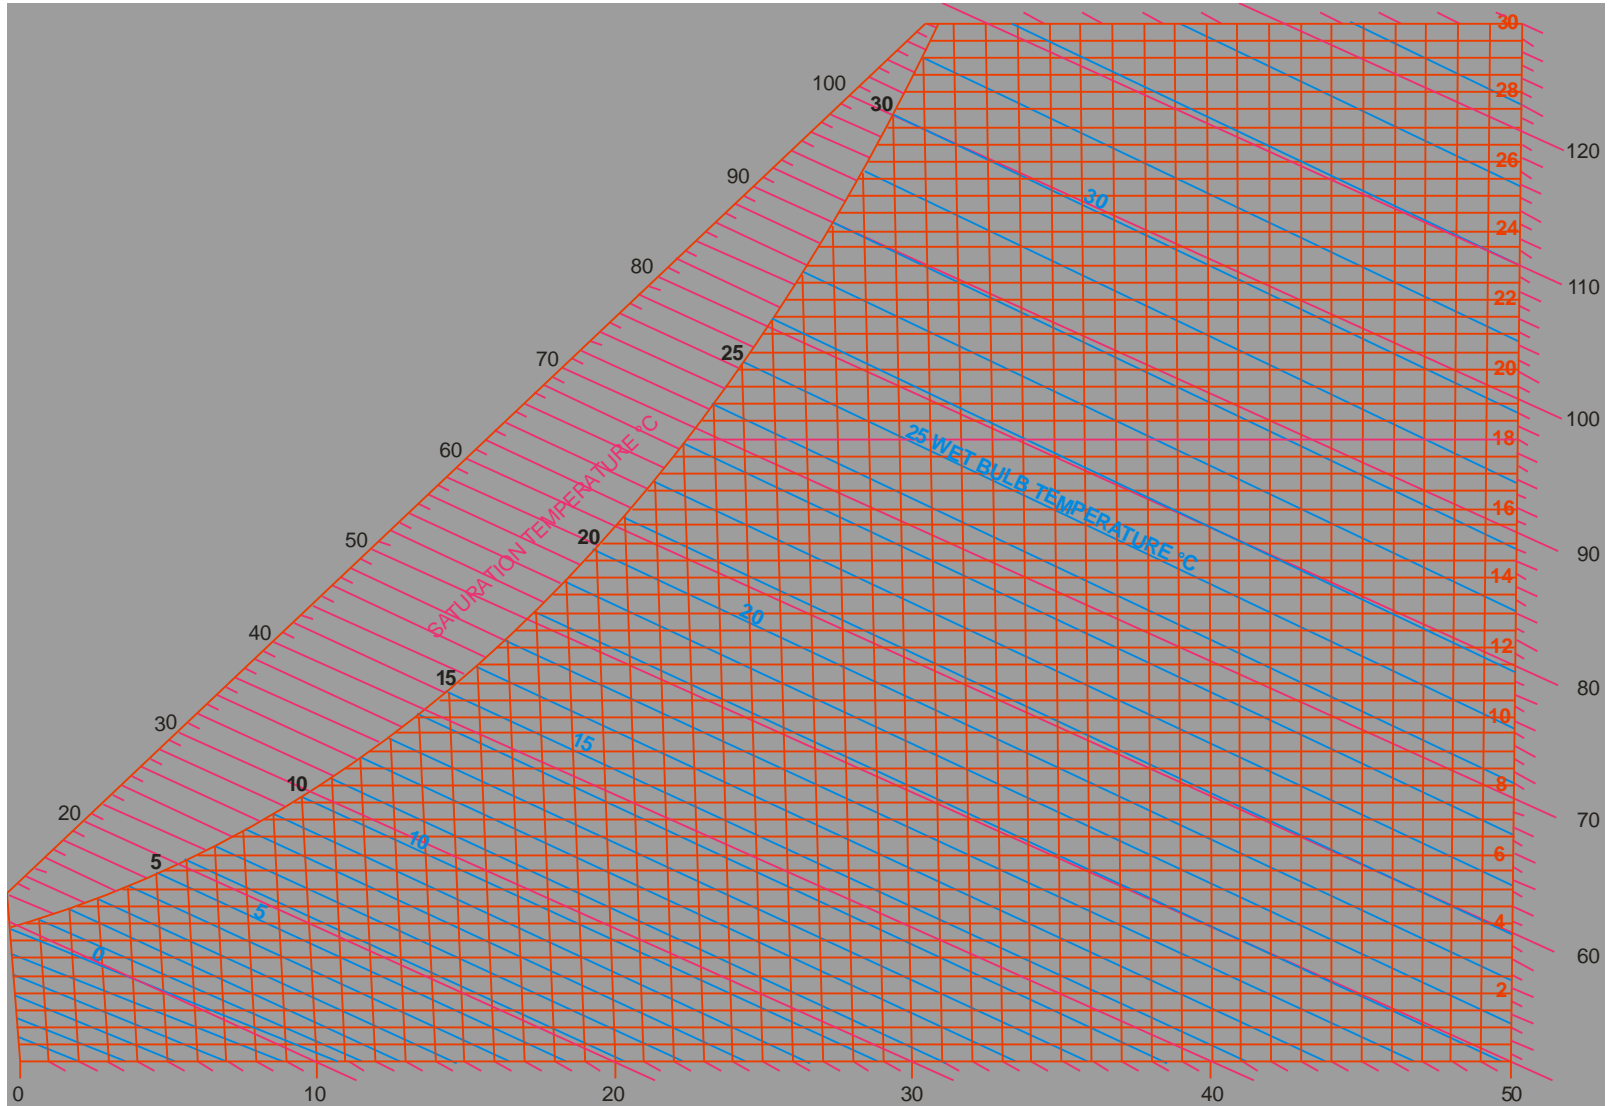



RELATIVE HUMIDITY LINES AT INTERVALS OF 10%

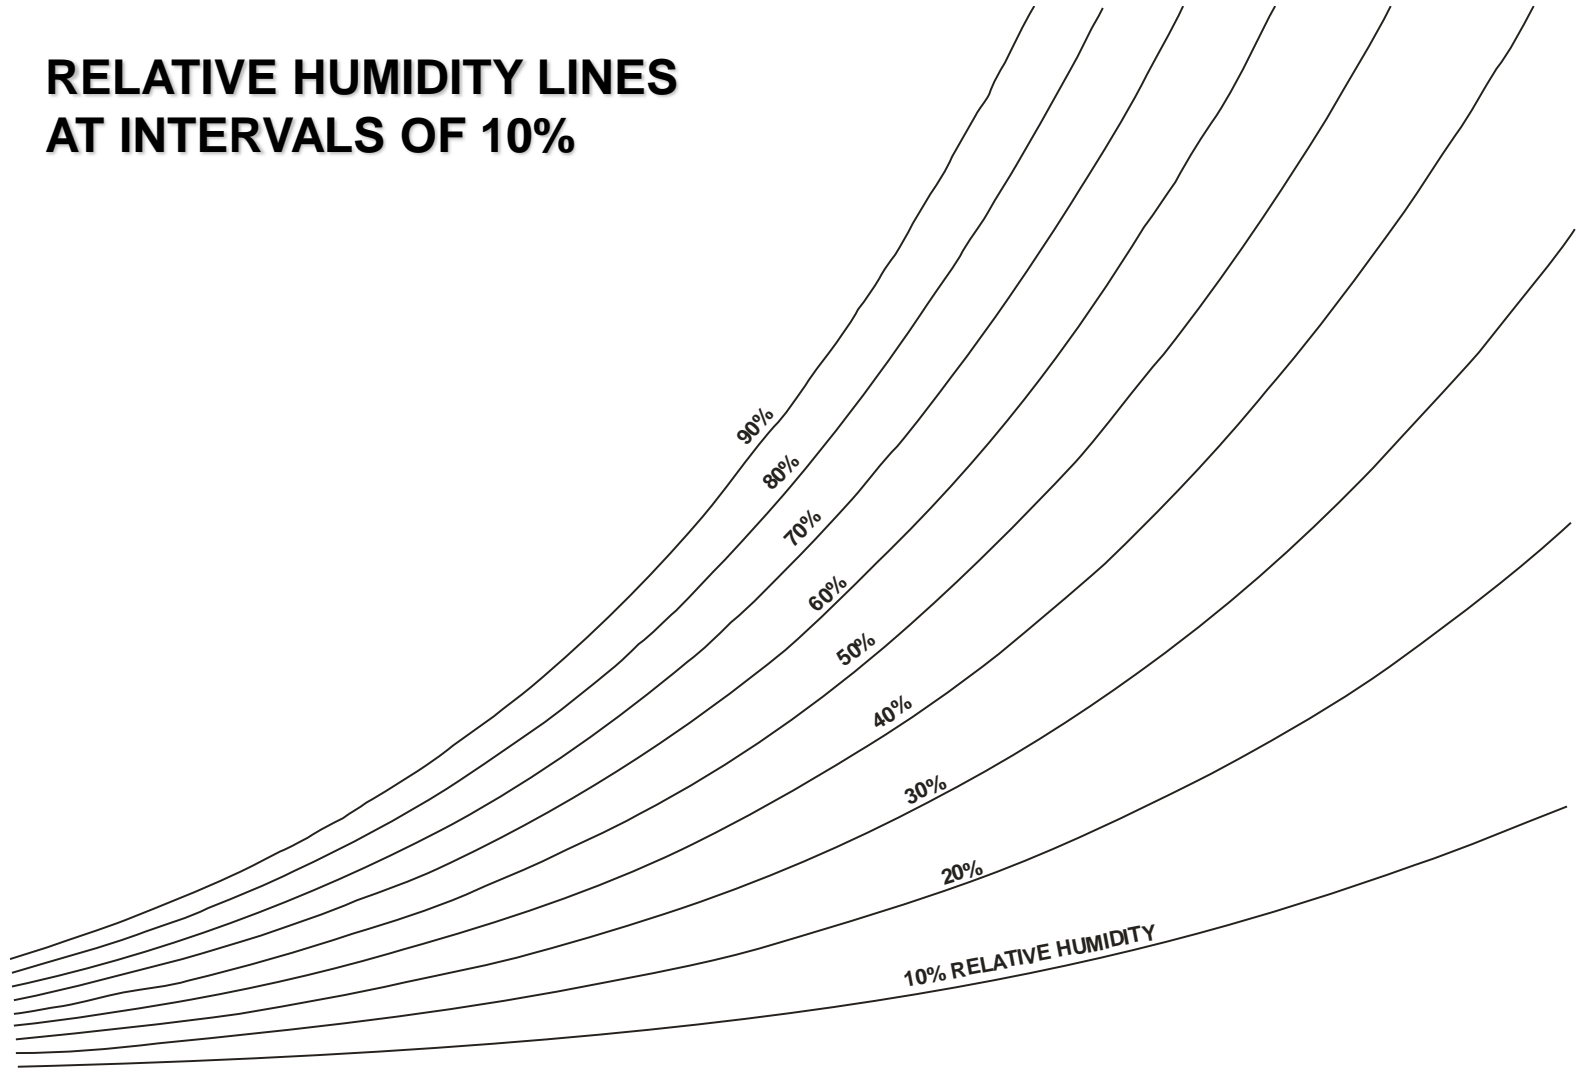

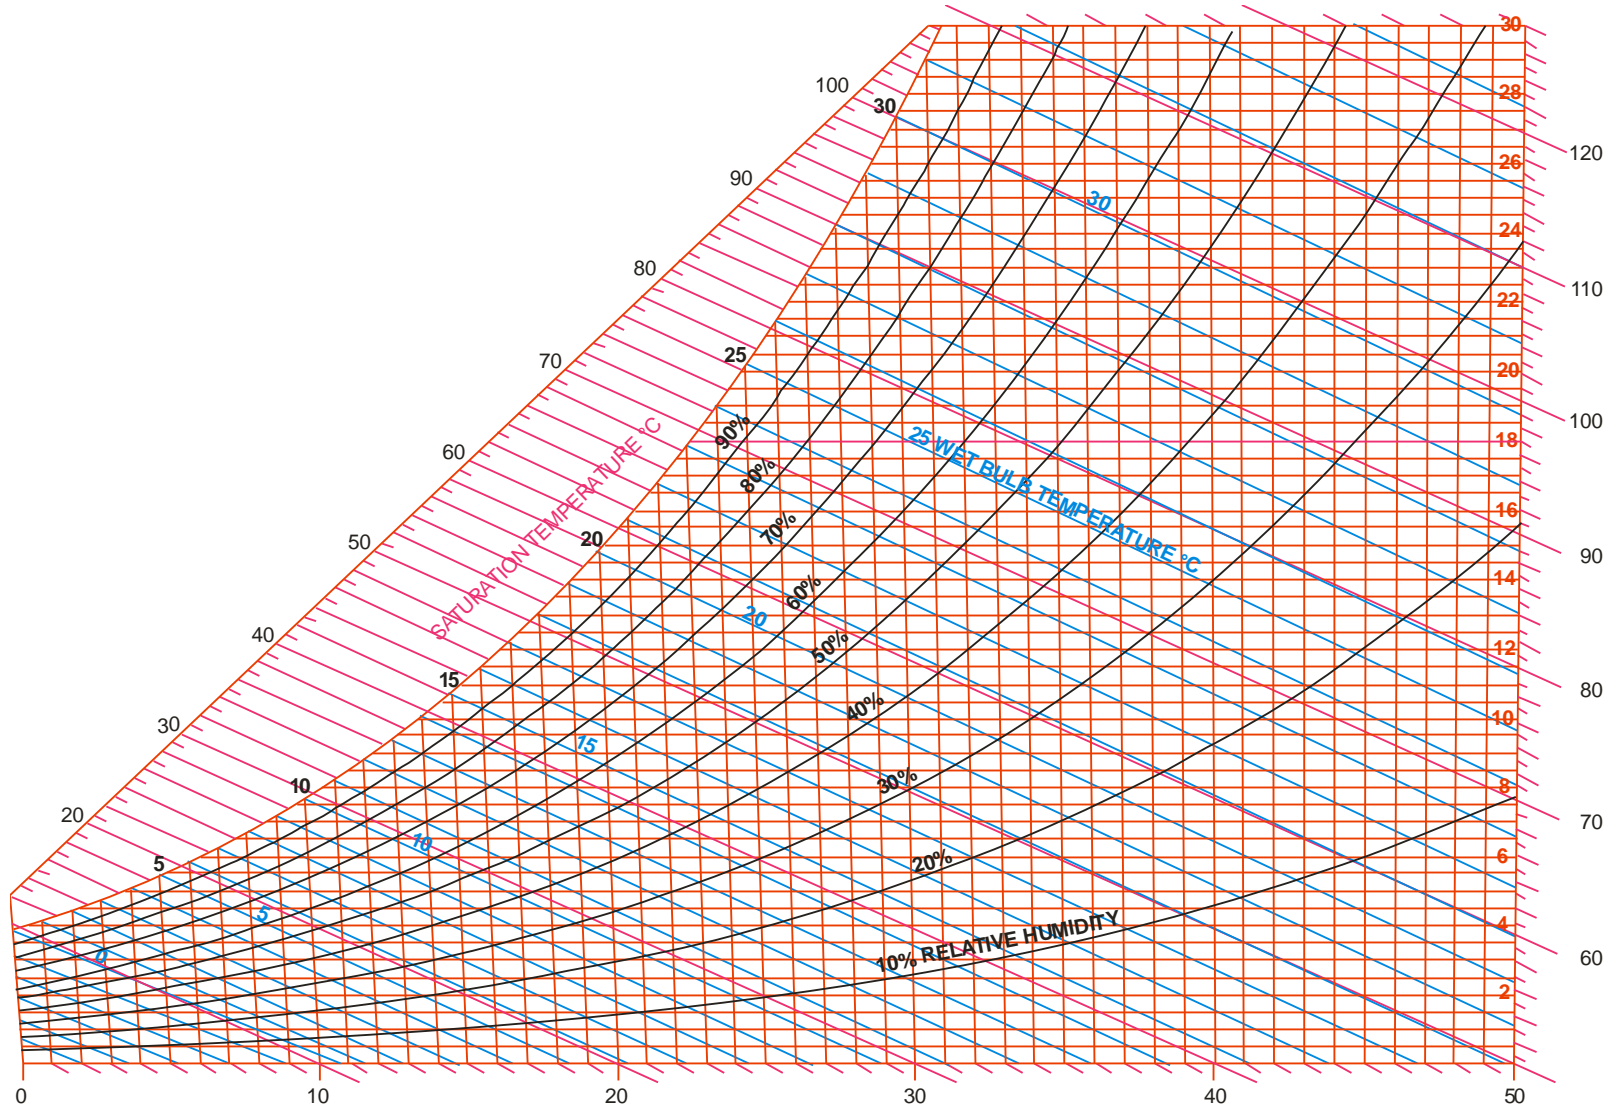



VOLUME LINES INDICATING CUBIC METER PER KILOGRAM DRY AIR

